

# Thermal energy storage for gas turbine power augmentation

## Review article

### Article history:

Accepted: 30 April 2019

Published: 19 July 2019

This paper is the updated version of a paper originally presented at the Global Power and Propulsion Technical Conference, GPPS Zurich19, in Zurich, Jan 15–16 2019.



### \*Correspondence:

VG: vgkoutzam@meng.auth.gr

### Peer review:

Single blind

### Copyright:

© 2019 Gkoutzamanis et al. This is an open access article distributed under the Creative Commons Attribution License (CC-BY 4.0), which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited and its authors credited.

### Keywords:

gas turbine inlet cooling; thermal energy storage; Phase change materials; combined cycle power plants

### Citation:

Gkoutzamanis V., Chatziangelidou A., Efstathiadis T., Kalfas A., Traverso A., and Chiu J. N. W. (2019). Thermal energy storage for gas turbine power augmentation. *Journal of the Global Power and Propulsion Society*. 3: 592–608. <https://doi.org/10.33737/jgpps/110254>

Vasilis Gkoutzamanis<sup>1,\*</sup>, Anastasia Chatziangelidou<sup>1</sup>, Theofilos Efstathiadis<sup>1</sup>, Anestis Kalfas<sup>1</sup>, Alberto Traverso<sup>2</sup>, Justin N. W. Chiu<sup>3</sup>

<sup>1</sup>Aristotle University of Thessaloniki, Greece

<sup>2</sup>University of Genoa, Italy

<sup>3</sup>Royal Institute of Technology, KTH, Sweden

## Abstract

This work is concerned with the investigation of thermal energy storage (TES) in relation to gas turbine inlet air cooling. The utilization of such techniques in simple gas turbine or combined cycle plants leads to improvement of flexibility and overall performance. Its scope is to review the various methods used to provide gas turbine power augmentation through inlet cooling and focus on the rising opportunities when these are combined with thermal energy storage. The results show that there is great potential in such systems due to their capability to provide intake conditioning of the gas turbine, decoupled from the ambient conditions. Moreover, latent heat TES have the strongest potential (compared to sensible heat TES) towards integrated inlet conditioning systems, making them a comparable solution to the more conventional cooling methods and uniquely suitable for energy production applications where stabilization of GT air inlet temperature is a requisite. Considering the system's thermophysical, environmental and economic characteristics, employing TES leads to more than 10% power augmentation.

## Introduction

In the 21st century, Combined Cycle (CC) flexibility and global efficiency are receiving the utmost research attention that is ought to. Moreover, the transition of the energy sector towards an electrical market with high penetration of renewable sources (RES), poses major challenges and opportunities for Original Equipment Manufacturers (OEMs) and utilities (Eser et al., 2017).

The gas turbine (GT) is one of the most important components in a CC power plant and hence, power augmentation technologies concerning this part have gained significant attention. From the power producers' point of view, this is important in using GT generators to provide on-peak power. On the other hand, from the power consumers' perspective who operate GT generators and purchase electricity from electric power companies, power augmentation is important to reduce demand and energy charges of electricity purchased (Yokoyama and Ito, 2004). The research activities for CCs flexibility focus mainly on the GT, aiming to extend the operational envelope of this component, mainly constrained by emissions. For the last decade, the main focus of power augmentation technologies is directed to inlet cooling systems as a cost-effective way to add machine capacity at times when peak power is required for warm and dry operational environments.

Initially designed to operate at ISO conditions (15°C ambient temperature, 101.32 kPa atmospheric pressure and 60% relative humidity), it is apparent that GTs operate mainly in off-design conditions, making them highly dependent on the ambient conditions. Among the various parameters, the ambient temperature causes the greatest performance variation during operation (Ponce Arrieta and Silva Lora, 2005). Furthermore, it is well known that reducing the air temperature results in higher air density, bearing in mind that the GT operates in a quasi-constant volumetric flow rate. This leads to increased air mass flows and thus, increased power output. Moreover, the mechanical work consumed to compress the denser air is reduced, leading to considerable thermal efficiency increase. The effect of ambient temperature on the power output and heat rate can be observed in Figure 1. The term “heat rate” refers to the amount of thermal energy required to obtain 1 kWh of electricity and is in the form of reverse efficiency, usually applied in power plants. According to the various scientific papers and based on the type of GT used (aeroderivative GTs are more sensitive to ambient conditions compared to heavy duty GTs — Bhargava and Meher-Homji, 2005), a power output decrease of 0.5%–0.9% is observed for every 1°C increase in ambient temperature (Kakaras et al., 2004; Cole et al., 2014).

Having discussed the above and in order to improve the performance of an industrial gas turbine, various available strategies have been studied in existing literature. The two main classifications are (Wang and Chiou, 2004; Bianchi et al., 2010; Gülen, 2017; Winkler et al., 2017):

- Inlet air cooling methods.
- Combustion improvement methods.

Of the two power augmenting techniques, the former is concerned herein as a feasible solution to determine the GT inlet conditions. Among the various cooling methods that are described in the following sections, the focus of this work is put on the thermal energy storage (TES) technologies and the way these are utilized to cool the inlet of the GT. The reason for that is twofold. On one hand, as an inlet air cooling method, latent heat thermal energy storage systems (LHTES) based on ice storage have received the most attention in the recent years (Sanaye et al., 2011). Additionally, apart from using solely ice, an interesting application that has emerged in the field of cold storage systems is the use of other phase-change materials (PCM), although this technology requires further development and investigation for a GT inlet air cooling implementation (Cheralathan et al., 2007; Bédécarrats and Strub, 2009). On the other hand, cold thermal energy storage is deemed an appropriate way in balancing the mismatch that occurs on the energy demand and supply.

While viewed as a review paper on the merits of TES in the cooling system of a large-scale gas turbine, it is deemed imperative to initially present all the GT compressor inlet cooling methods. The TES systems are then thoroughly explained followed by a case study section aiming to assess the impact of such systems in the performance of a GT or the CC as a whole. Last but not least, a state-of-the-art section discusses the optimization studies and some contemporary technologies that are currently under development and may potentially lead to further improvement on the aforementioned systems unit sizing and cost.

## Gas turbine inlet cooling

As already stated, the reduction of GT inlet temperature leads to power output and energy efficiency increase. Despite there are many different cooling methods, they are subject to the same limitations. First, the GT

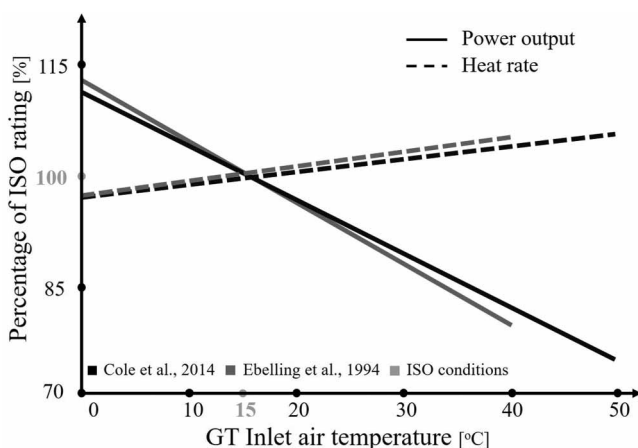


Figure 1. Effect of inlet temperature on GT performance.

mechanical characteristics and the electric power generator limitations. These include engine speed limits, mechanical tolerances and maximum heating losses that can be sustained by the armature windings in the alternator.

Secondly, icing formation that can occur below a specific temperature, if the saturated inlet air is cooled near the dew point. This imposes a temperature constraint ( $\sim 5.5\text{--}7.2^\circ\text{C}$ ) as ice-crystals may lead to severe erosion and wear of the intake guide vanes (Sigler et al., 2001; Chacartegui et al., 2008). Being aware of the latter, the techniques (Figure 2) used to cool the air entering the GT may be classified into direct and indirect methods.

Direct methods consist of the following segments:

- Water evaporation methods (Evaporative cooling, inlet fogging).
- Refrigeration methods (Mechanical refrigeration and absorption chilling).
- Hybrid and other methods (these mostly are sub-categories or combinations of the two major direct cooling classifications).

Indirect methods include cooling techniques that take advantage of a TES system and are thoroughly described in the following section.

The main characteristics and major advantages and disadvantages of the direct cooling methods are highlighted in Table 1. One general conclusion that can be drawn according to the available scientific literature is that there is no strict rule as to what technology is the best to be applied in each configuration. For example, evaporative cooling method is cost-effective and simple but is limited by the ambient air relative humidity. Mechanical and absorption cooling methods overcome this limitation but either consume electric power for their operation thus imposing parasitic losses or they are limited to refrigerant cooling temperatures. For instance, using an ammonia-water absorption machine may cool the inlet air to lower temperatures than the lithium-bromide technology (Sigler et al., 2001) but the negative effects are that this solution has toxicity related issues.

The various studies underline that the choice of each application is a multi-parametric task that depends on the climatic and economic conditions that dominate along with the power requirements that characterize the respective network (De Lucia et al., 1996). The two main points that are deemed as viable solutions for the future and require further investigation are a decoupling of the refrigeration system from the actual peak times when prices are high and an advanced control system for real-time supervision aiming for optimal solutions and overall flexibility enhancement. One such decoupling technology is enabled by the use of a thermal energy storage system, to lower electricity consumption during peak hours. Decoupling necessitates the use of an integrated inlet conditioning system that will allow for the full exploitation of the power plant installed capacity. In contrast to the aforementioned refrigeration techniques, the addition of TES produces only minimal parasitic losses during the time of maximum energy requirements.

Of the various TES systems, latent heat TES have the strongest potential towards an integrated inlet conditioning system regarding GT compressor inlet cooling. Their high energy density and compactness along with the quasi-constant melting and freezing temperatures make them uniquely suitable for such applications, where stabilization of the GT air inlet temperature is important. The effect of the storage type on the GT cooling is studied in the following.

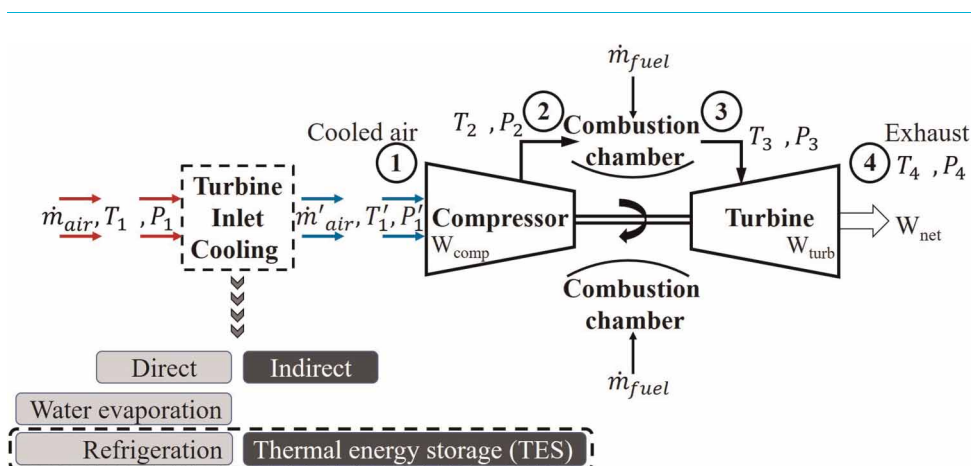


Figure 2. Overview of GT inlet cooling systems.

Table 1. Design considerations of the GT cooling methods found in the literature.

Methods	Advantages	Disadvantages	Considerations
<p><b>Evaporative cooling</b> (<i>wetted media</i>) Mixing of water with the GT inlet air stream cools the inlet air, as the water evaporates, and latent heat of evaporation is absorbed from surrounding air.</p>	<ul style="list-style-type: none"> <li>• Continuous inlet air-cooling operation.</li> <li>• High quality water is not a prerequisite.</li> <li>• No risk of over-spraying or supersaturation.</li> <li>• Low parasitic power consumption.</li> <li>• Short delivery and installation time.</li> <li>• Simplicity of design and operation.</li> <li>• Economically feasible for hot and dry climates. Low unit capital cost.</li> </ul>	<ul style="list-style-type: none"> <li>• Highly dependent on ambient conditions (temperature and relative humidity).</li> <li>• Limited potential in humid regions.</li> <li>• Large amounts of water are required.</li> <li>• Installation time is longer (~100%) compared to fogging systems.</li> <li>• Pressure drop is higher than fogging systems.</li> <li>• Capital and maintenance costs are usually higher (~20%) than fogging systems.</li> </ul>	<ul style="list-style-type: none"> <li>• <b>Site and climate</b> Ambient temperature, relative humidity and altitude of the facility.</li> <li>• <b>Water employment</b> Water availability, consumption, treatment (demineralization) and costs.</li> <li>• <b>Type of GT used</b> Some GT technologies are more vulnerable to compressor erosion than others. This limits the amount of water that can be injected.</li> <li>• <b>Power output</b> Performance improvement after applying the GT inlet cooling method. In this matrix, the parasitic power consumption and inlet pressure drop must be considered.</li> <li>• <b>Economic evaluation</b> Capital costs and added value from the investment. This includes payback period and installation costs of the cooling system per incremental power increase. Also, one should take into account that gas and electricity prices vary in time. Moreover, the fuel costs must be considered. Operations and maintenance (O&amp;M) costs are also included here. If TES is used to store energy, "Energy Arbitrage" applies so that the overall economic outcome is not a conflicting factor with the thermodynamics of the system.</li> <li>• <b>Environmental impact</b> Inlet cooling can be beneficial for the NO<sub>x</sub> and CO<sub>2</sub> emissions. Selection of the refrigerant fluid and sealing of the corresponding system must be performed carefully.</li> </ul>
<p><b>Inlet fogging</b> (<i>fogging/overspray techniques</i>) Inlet fogging systems consist of very fine water droplets that are sprayed into the air through atomizing nozzles and evaporate prior to reaching the compressor. Overspraying (high pressure fogging or wet compression) allows excess fog.</p>	<ul style="list-style-type: none"> <li>• Continuous inlet air-cooling operation.</li> <li>• Efficiency of humidification is 90–100%.</li> <li>• Low parasitic power consumption.</li> <li>• Low annual maintenance time.</li> <li>• Simplicity of design and operation.</li> <li>• Short delivery and installation time.</li> <li>• Economically feasible for hot and dry climates. Low unit capital cost.</li> <li>• In over-spraying a compressor intercooling effect is created by allowing part of the evaporation take place inside the compressor, as the air is heated up.</li> </ul>	<ul style="list-style-type: none"> <li>• Efficiency is limited by the wet bulb on inlet air temperature.</li> <li>• Water requires special treatment for demineralization.</li> <li>• Duct surfaces are wetted with demineralized water which requires measures against duct corrosion. These include additional filters and drainage systems.</li> <li>• Risk of erosion of compressor blades.</li> <li>• Inlet fogging requires the modification of a large part of the air inlet which results in a required-additional investment.</li> </ul>	
<p><b>Mechanical refrigeration</b> (<i>vapor compression cycle</i>) Intake air is cooled as it flows through HEXs that utilize either the refrigerant fluid from the vapor compression cycle or chilled water from thermal energy storage systems.</p>	<ul style="list-style-type: none"> <li>• Continuous inlet air-cooling operation.</li> <li>• Allows for a wider range of inlet conditioning and hence, greater power augmentation as compared to water evaporation methods.</li> <li>• Better performance and independent of ambient-air wet-bulb temperature as compared to water evaporation methods.</li> <li>• Simplicity of design and operation.</li> </ul>	<ul style="list-style-type: none"> <li>• Running this cycle requires high electrical power to drive the compressor. This results in the largest parasitic losses on the net generated power of the plant, compared to all other methods.</li> <li>• High capital costs.</li> <li>• High O&amp;M expertise and costs required.</li> <li>• Longer delivery and installation time compared to water evaporation methods.</li> </ul>	

(Continued)

Table 1. Continued

Methods	Advantages	Disadvantages	Considerations
<p><b>Absorption chilling</b> (<i>absorption refrigeration cycle</i>)</p> <p>The operation of such systems is to recover heat from the GT exhaust streams, employing the heat recovered to produce cooling. Two working fluids are used: the first one as the absorbent (LiBr or NH<sub>3</sub>) and the second one as the refrigerant (water).</p>	<ul style="list-style-type: none"> <li>• Continuous inlet air-cooling operation.</li> <li>• Parasitic losses are minimized as the energy required to run the compressor of the cooling cycle is extracted from GT exhaust gases.</li> <li>• Makes use of un-tapped energy.</li> <li>• Greater power augmentation and independent of ambient-air wet bulb temperature, as compared to water evaporation methods.</li> <li>• Lower O&amp;M costs as compared to mechanical refrigeration.</li> </ul>	<ul style="list-style-type: none"> <li>• Corrosive nature if lithium-bromide is used in the absorption refrigeration system. This leads to a reduction of the overall life of the system. Ammonia-water technique is corrosive when used with copper.</li> <li>• Careful sealing of the refrigeration system must be performed to prevent leakages.</li> <li>• Higher heat rejection requires higher cooling tower and pump capacities. High capital costs.</li> <li>• High O&amp;M expertise and costs required.</li> <li>• Longer delivery and installation time compared to water evaporation methods.</li> </ul>	
<p><b>Hybrid systems</b></p> <p>Combinations of two or more of the previously presented systems which may also incorporate thermal energy storage systems (TES).</p>	<ul style="list-style-type: none"> <li>• Less water can be used.</li> <li>• Provide operational flexibility to the cooling system to cover the demand.</li> <li>• Avoid high parasitic load in periods with high electricity tariffs.</li> <li>• May achieve inlet temperature reduction with less power and water consumption.</li> </ul>	<ul style="list-style-type: none"> <li>• Complex systems requiring operational and maintenance expertise.</li> <li>• Because of the above, if not designed properly, capital costs can become immoderate.</li> <li>• Literature of the hybrid system effects on GTs is limited.</li> </ul>	
<p><b>Other systems</b> (<i>LNG vaporization/coolant pre-cooling/evaporative cooling of pre-compressed air</i>)</p>	<ul style="list-style-type: none"> <li>• Innovative methods.</li> <li>• Potential economic and power enhancement.</li> <li>• In LNG vaporization, LNG is initially cooled to be transferred and then re-heated to be transmitted to the users. As such, it has a significant cooling potential.</li> </ul>	<ul style="list-style-type: none"> <li>• Innovative methods.</li> <li>• Not yet proven technologies.</li> <li>• Not yet proven economic feasibility.</li> <li>• LNG vaporization only applicable in LNG storage sites and corresponding facilities.</li> <li>• Reliability and safety.</li> </ul>	

Al-Ansary et al., 2013; Al-Ibrahim and Varnham, 2010; Alhazmy and Najjar, 2004; Ameri et al., 2007; Ameri and Hejazi, 2004; Baakeem et al., 2018; Bhargava and Meher-Homji, 2005; Boonnasa et al., 2006; Bracco et al., 2007; Chacartegui et al., 2008; Farzaneh-Gord and Deymi-Dashtebayaz, 2011; Kakaras et al., 2006; Kwon et al., 2016; Kim and Ro, 2000; Meher-Homji and Mee, 2000; Palestra et al., 2008; Sigler et al., 2001.

## Thermal energy storage

When it comes to large-scale power production systems, especially those that include electricity generated from renewable sources, several types of storage technologies can be developed and implemented (Ibrahim et al.,

2008). One type of storage systems is the thermal energy storage (TES) that can be combined with the above-mentioned direct cooling methods and constitute an indirect cooling mechanism. TES appears to be the most suitable method for correcting the discrepancy that usually occurs between the supply and demand of energy (Dincer and Rosen, 2010). Despite that the benefits are not evident since they are not immediate in many cases, the potential energy savings and climate change mitigation combined with their simplicity make it a favorably promising technology for the future (Cabeza et al., 2015). One of the innovative performance enhancement techniques integrates a TES tank with the GT compressor inlet cooling system to reduce on-peak electricity consumption. This is achieved by charging the cold TES at off-peak hours (during the night) while electricity prices are lower and discharging it during peak hours to increase GT power output when prices are high (Bédécarrats and Strub, 2009; Sanaye et al., 2011). Primarily, two types of TES systems can be used for inlet cooling of a gas turbine:

- Sensible heat TES.
- Latent heat TES.

Apart from solely considering the thermodynamics and performance, the economic outlook of such systems is also an essential parameter in selecting the most suitable technology.

### Inlet cooling with sensible heat TES

The first classification of cold thermal storage is the system that utilizes the sensible heat that is stored (or released) during the charging/discharging of the storage media. Sensible heat is the amount of heat released/absorbed due to a temperature change in the storage material. Phase change does not take place in this type of storage systems. The most commonly used storage medium is the water. However, other aqueous fluid solutions can be employed in the following sensible heat storage technologies.

#### Stratified chilled water

This is a conventional method of sensible TES. The amount of stored energy depends on the temperature difference between the stratified layers of water. These layers are formed in a vertical orientation inside the storage tank and are scaled temperature zones based on the water density. The stratification inside the tank defines the cooling capacity of the system as it depends on the temperature differential across the tank height. A good design of stratified tank consists of a thermocline range of approximately 0.3–1.0 m which depends on the diffuser design and the time that the water remains stored inside the TES. The tank is charged with water at 4–6°C. During discharge, the cold-water flows reversely from the tank to the system, employs cooling, and returns to the top layers of the tank in a higher temperature at low flow rates, in order to minimize the mixing of the layers (Hasnain, 1998).

The simplicity and proven reliability combined with the relatively low cost make it an easily applicable and well-established technology. Additionally, it provides greater performance augmentation as compared to the water evaporation methods. One of its major drawbacks is the low storage capacity per unit volume. This effect is magnified if the requirement in temperature difference between the cold and warm water is small (Palestra et al., 2008). Hasnain (1998) emphasizes that statement, proving that each cubic meter can deliver only 5.8 kWh of cooling if the requirement in temperature rise is 5°C. Another disadvantage of this technology is that it only provides limited hours of cooling per day which is a characteristic of all thermal energy storage systems.

#### Other aqueous stratified solutions

In order to further reduce the inlet air temperature at the lowest possible solution to avoid icing, water is replaced with other fluids such as brines, calcium chloride (CaCl<sub>2</sub>) and glycol (Quinnell et al., 2010). Despite their benefits such as operating below the freezing point of water, these solutions are expensive or tend to be corrosive and require specific treatment to avoid these events.

### Inlet cooling with latent heat TES

As already mentioned earlier, LHTEs have the strongest potential towards an integrated and decoupled operation of the GT inlet conditioning system. This storage type takes advantage of the latent heat that is exchanged whenever a storage material changes its state. Unlike the sensible heat TES, this method provides higher energy density with a smaller temperature difference during charging and discharging. Additionally, it requires a reduced installation area.

Systems such as ice-on-tubes, ice harvesters, ice slurries, and encapsulated ice (or various other PCMs) are some of the identified LHTES that have received the most attention in the recent years due to the benefits that emerge from material phase change in these applications (Cheralathan et al., 2007). Normally, the LHTES is classified as either a static or a dynamic system (Saito, 2002). When referring to static systems, a layer of ice is formed on tubes or plates which are submerged in a tank of water. This layer increases the thermal resistance between the cooling surface and the solid-liquid interface, thus leading to a decrease in the system performance. On the other hand, this problem is avoided in dynamic storage systems where the layers of ice (or in general the solid form of other materials) is systematically or continuously removed. However, when using water as the phase change material in such systems, icing is not desirable after a specific limit — that is, the formation of ice on the outside of vertical evaporator plates. This necessitates the use of external forces to remove the ice and hence, leads to system efficiency losses. This is one of the reasons why studying different materials provides a strong motivation in this area.

Static systems include ice-on-tube, glycol-water (or ethylene-glycol-water) heat exchangers inside ice tanks and encapsulated storage systems. The dynamic systems include ice harvesters and ice slurries, or slurries composed of different materials (Hasnain, 1998). Apparently, these configurations are valid for other PCMs as well, a description of which is given later in this work.

### Ice-on-tube

In this configuration, a TES tank is filled with a number of metallic (aluminum, copper, steel) or plastic tubes usually placed in a horizontal orientation either in parallel or in a spiral/helical coil configuration as shown in Figure 3a. The tubes are surrounded by water and a heat transfer fluid (HTF), usually brine that flows through them. As the cold HTF flows through the tubes, ice is formed perimetrically. Whenever the tank is required to supply cooling, the warmer HTF flows through the tank leading to ice melting.

### Glycol-water submerged heat exchanger

In this solution (Figure 3b), heat is transferred to the HTF through the heat exchanger from the storage material during the charging process and is then discharged when cooling is required by the system, respectively. Research interest to further enhancing the thermal performance of such systems has led to several alternatives such as the incorporation of fins either orthogonal or cylindrical (Chiu and Martin, 2012).

### Encapsulated storage systems

The research of encapsulated storage technologies has received increasing attention over the past years. The main advantages of this method are the increase of heat transfer they provide and that they prevent mixing with the HTF (Bédécarrats et al., 1996). Various studies have been conducted to analyse the thermal behaviour of these systems (Felix Regin et al., 2009). The design and the size of encapsulated storage determines the heat transfer surface and thus, the thermal performance of the system (Figure 3c).

### Ice harvester

This option uses the solid pieces of ice which are formed on the external cold surfaces of evaporators. As a result, solid slabs of ice are formed on the flat evaporator plates. At the time when a certain thickness is reached, the ice is harvested by heating the evaporator and allowing the ice slabs to fall by gravity into a storage tank below (Al Bassam and Al Said, 2001). The heat required by the harvesting process is accomplished by using the hot refrigerant gas from the chiller compressor (Palestra et al., 2008).

### Phase change slurries

This dynamic type of storage is also a technology with high potential as it may lead to higher thermal power. In this method, direct contact between the HTF and the storage material (ice or other PCM) is achieved by forming an emulsification with increased thermal storage and heat transfer capacity. This solution also shown in Figure 3d is desirable when aiming for high thermal power. However, it remains a rather new and costly technology which also inheres the risk of system fouling to pipes, heat exchangers and pumps. Regarding ice slurries, brine is considered to be the continuous phase while ice crystals consist the dispersed phase. Mouneer et al. (2010) have reported six types of ice slurry production which include mechanical scraping, fluidized bed, direct contact or direct injection, vacuum freezing, oscillatory moving cooled wall and supercooling methods. With respect to other PCM slurries, the HTF is the continuous and the PCM the dispersed phase (Youssef, 2013).

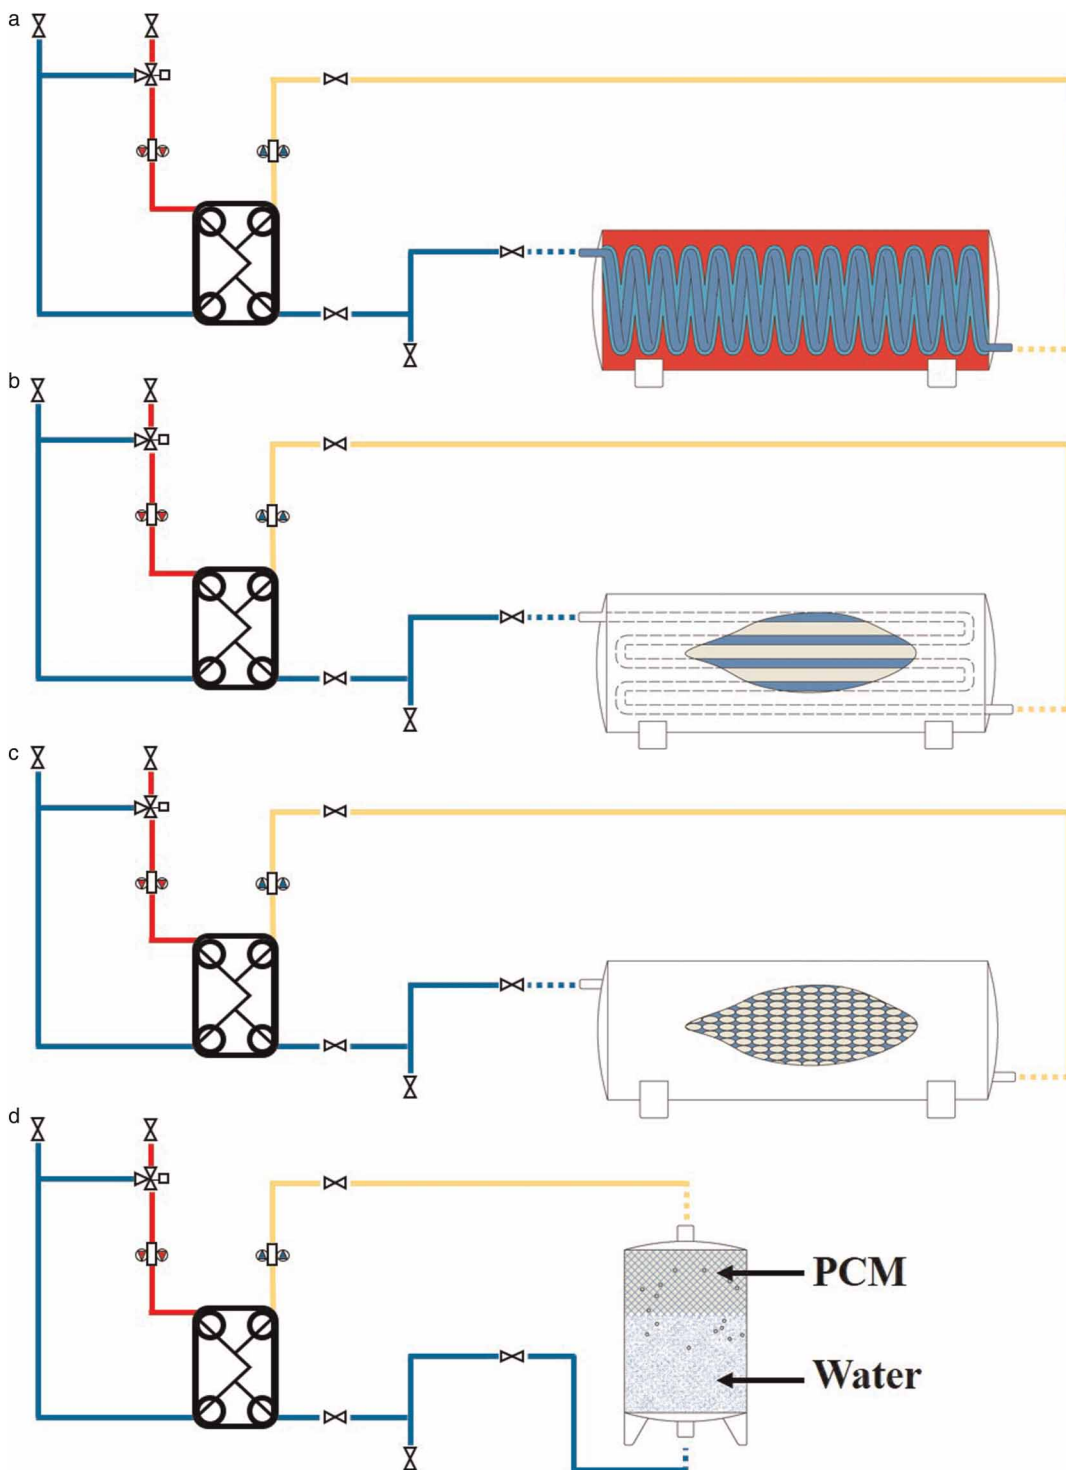


Figure 3. TES systems – (a) ice forming on tubes, (b) submerged heat exchanger, (c) encapsulated storage, (d) ice slurries.

### Phase change materials (PCM) in cold TES

The PCMs are organic, inorganic and eutectic materials. The organic PCMs are carbon-based compounds and can be generally classified as paraffin and non-paraffin materials. Inorganic PCMs are classified into metallic and hydrated salts while eutectic PCMs are combinations of the two former categories with their main purpose being to achieve a desirable melting point. A thorough analysis of such materials can be found in the study of [Veerakumar and Sreekumar \(2016\)](#).

The major advantages of the organic PCMs are their non-corrosive nature with metals, the almost negligible supercooling properties, the high latent heat and recyclability. Their drawbacks consist of a low thermal



conductivity, large volumetric change during phase change process and flammability, which, in the case of power production facilities is of utmost importance. As a result, they usually require specific treatment as encapsulation which results in higher capital and other variable costs (for example capsule replacement).

On the other hand, inorganic compounds such as salt hydrates and composites have much higher latent heat per unit volume, higher thermal conductivity, lower cost, are recyclable and non-flammable. Their corrosive nature with metals reduces the life of the system and increases the overall costs of the system (Cabeza, 2015).

Focusing on each specific application of the TES system, there are conflicting requirements that must be investigated prior to the final material selection. For this reason, there are several quality criteria that need to be met and are based on the dynamics of melting or solidification of PCM. The main requirements are the (i) stored energy or thermal inertia, (ii) the discharge power and (iii) the discharge time. These must be sought to achieve high efficiency, robustness and viability of the products (Vitorino et al., 2016).

## Discussion

As described so far, both TES systems have advantages and disadvantages. However, LHTES appears as the technology with improvement potential, especially if other PCMs are used, instead of ice. Compared to the sensible heat storage technologies its main superiorities are:

- Lower space requirements and larger cooling capacities providing increased energy density.
- Lower thermal losses due to smaller TES tanks which comprise of smaller surface areas.
- Potential recovery of thermal energy in quasi-constant temperature.
- Ability to store significantly larger amounts of energy in cases where the temperature difference between the heat source and heat sink is small.
- Storing of energy at a better efficiency during low-priced off-peak periods. The ratio of the useful cooling latent heat stored to the useful sensible heat is much higher (4–7 times). This reduces the size of the PCM-based TES as compared to the respective sensible heat TES system (Cheralathan et al., 2007).
- Stratification requirement is eliminated.
- Lower cost of maintenance if encapsulated systems are considered as it facilitates the removal of damaged capsules.
- Allowance for an overall downsizing of the system with reduced costs of pumping and air distribution (linked to the lowest possible storage temperatures).

As far as the PCM is concerned, the main material that is used in the literature is water. Its advantages are the durability, high latent heat of freezing, cost-effectiveness and zero environmental impact. However, the occurrence of supercooling and incongruent freezing and melting requires the use of additives to eliminate such phenomena. Supercooling is not desirable in such systems as the temperature of PCMs goes beyond the nominal phase change temperature, thus leading to inability in fully storing heat and additionally, makes it harder for the control systems to adapt as they operate in certain temperature margins.

This leads to the need for further research about materials, to limit the shortcomings that emerge from the use of ice. The literature involving the performance of traditional GT cooling techniques (such as chillers) with storage systems consisting of innovative PCMs is rare. Along with the need for solely studying the materials as an individual parameter, further development and investigations are required when combined with the GT inlet cooling implementation (Barigozzi et al., 2011). All in all, to achieve high efficiencies with TES for the various applications, it is important to consider the system's thermophysical, environmental and economic characteristics (Dincer and Rosen, 2010).

## Case studies

The next step after scrutinizing through the available GT cooling methods and the thermal energy storage systems is to provide results based on prior studies that are reported in existing power plants, globally (Figure 4). The cases considered include nearly all of the cooling methods as they have been presented previously in this work. The target is to draw conclusions by evaluating the change in the system performance with the varying operating conditions.

Table 2 includes the corresponding characteristics (ambient conditions and rated power output) of the selected power plants. The results are based on a total of thirteen case studies which are based on calculations performed for existing, simple gas-turbine (GT) or combined cycle (CC) power plants with rated power varying from 1MW<sub>el</sub> to approximately 400MW<sub>el</sub>. The indexes used in some GT or CC plants represent a different type of engine used in the corresponding study. Otherwise (no index is used), all cooling methods are applied onto the

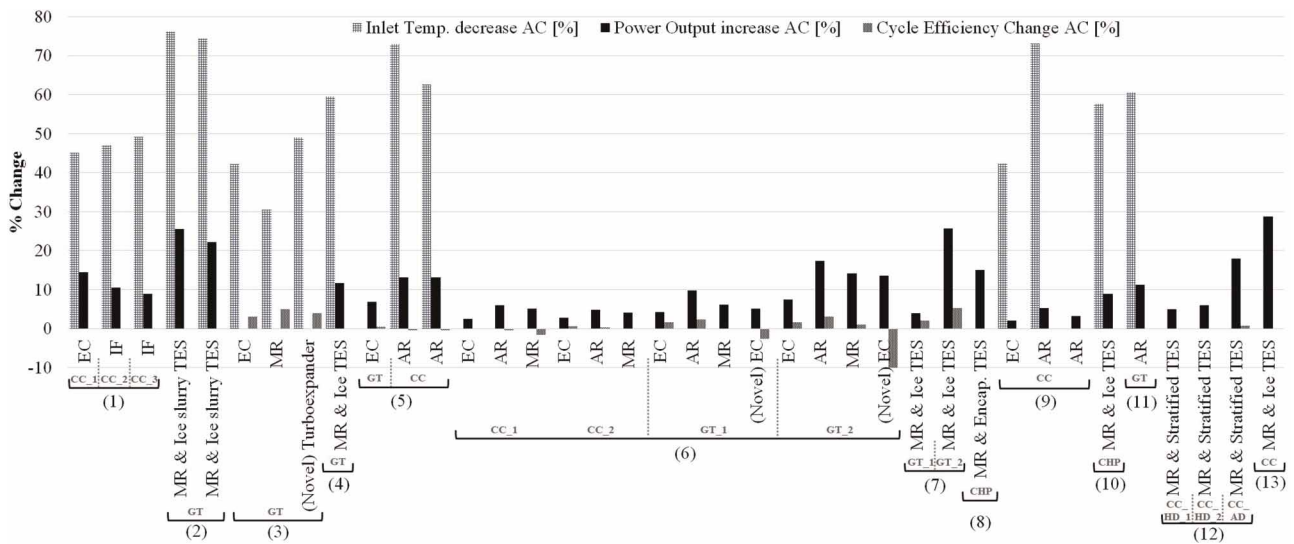


Figure 4. Cumulative graph of the inlet cooling method effects on the performance of GTs.

same system. The criterion chosen for the reference setting of the cumulative graph is the incremental relative humidity (RH). Therefore, the case studies considered first are characterized by hot and dry climate. As the results unwrap, the analysis progresses to humid conditions. Emphasis is put on considering the impact of the selected cooling method on the performance of the gas turbine and the efficiency of the overall cycle if this is provided in each corresponding work. The ambient temperature indicated in the case studies represents either the maximum value or the average temperature distribution of the site location.

As far as the results are concerned, it is initially observed that the power augmentation in all case studies varies from 2% to 30% based on the site climatological conditions, the method employed and the size of the plant. On the other hand, the effect can sometimes be adverse with regard to the efficiency of the power plant as a whole. The cases where negative values of efficiency occur are mainly observed whenever refrigeration methods (MR, AR) are employed in CC power plants or novel EC techniques are applied in simple GT plants. The novel EC technique indicated in the sixth (6) case study corresponds to the utilization of an electrically driven fan to pre-compress the inlet air which is then cooled by the EC. A conclusion that can be drawn is that despite the performance improvement of the GT, the implementation of inlet cooling can have a negative effect in the overall combined cycle efficiency. As the turbine outlet temperature is decreased a net reduction in the overall power output is observed due to less energy recovery from the steam turbine.

Moreover, another conclusion is that the EC method is not very effective in areas of humid climate. This is interpreted due to the low power augmentation and its rare application in such areas as compared to the refrigeration methods.

Furthermore, for what concerns the type of GT used, aeroderivative machines have better performance improvement as compared to heavy duty engines. This is shown in case study (12) where the third studied engine corresponds to a high-performance aero-derivative engine that is highly sensitive to the inlet air temperature variation.

As far as TES are considered, the integration of a cooling method with TES allows the designer to select a lower capacity GT. Based on the results of Figure 4, the potential of using a refrigeration chiller with TES leads to notable output power improvement (more than 10%) compared to other methods for power plants with rated power up to 100MWel. TES systems are mostly applied to such applications whereas literature of larger capacity power plants employing LHTES is scarce. The works of Al Bassam and Al Said (2001) and Ebelling et al. (1994) showcase the increase in power output, after employing inlet cooling with TES. It is at this point where it can be understood the necessity to also consider economical aspects in each study so as to evaluate if the investment of adding a TES system is feasible.

Having discussed the above, the available economics described in each of the aforementioned case studies are presented (Table 3). These are costs which correspond to the cooling methods employed and either include capital and investment costs for the selected method or incremental cost of electricity generation per increased MWh. As it would have been misleading to only include one currency (e.g. Euro) for each type of economic result, the results are kept as they are presented in each study. The numbers indicated refer to the power plants described so far.

Table 2. Rated power output and ambient conditions of the investigated power plants.

<b>(1) Ameri et al. (2007)</b>	Location: Western Asia	<b>(7) Sanaye et al. (2011)</b>	Location: Western Asia
<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>	<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
- CC_1: 99.3 MWel	- RH_1: 8.2%, Temp: 38°C	- GT_1: 25 MWel	- RH: 50%, Aver. Temp: 25°C
- CC_2: 98.0 MWel	- RH_2: 11%, Temp: 35°C	- GT_2: 100 MWel	
- CC_3: 100.0 MWel	- RH_3: 16%, Temp: 32°C		
<b>(2) Al Bassam and Al Said (2001)</b>	Location: Western Asia	<b>(8) Bédécarrats and Strub (2009)</b>	Location: Southern Asia
<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>	<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
- GT: 342.0 MWel	- RH_1: 10%, Temp: 44°C	- CHP: 1.0 MWel	- RH: 60%, Aver. Temp: 32°C
	- RH_2: 10%, Temp: 39°C		
<b>(3) Farzaneh-Gord and Deymi-Dashtebayaz (2011)</b>	Location: Western Asia	<b>(9) Gareta et al. (2004)</b>	Location: Southern Europe
<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>	<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
- GT: 7.5 MWel	- RH_1: 20%, Temp: 43.2°C	- CC: 395.0 MWel	- RH: 65%, Aver. Temp: 26°C
<b>(4) Shirazi et al. (2014)</b>	Location: Western Asia	<b>(10) Yokoyama and Ito (2004)</b>	Location: Eastern Asia
<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>	<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
- GT: 62.3 MWel	- RH_1: 30%, Temp: 37°C	- CHP: 5.72 MWel	- RH: 65%, Aver. Temp: 16.5°C
<b>(5) Kakaras et al. (2004)</b>	Location: Southern Europe	<b>(11) Ameri and Hejazi (2004)</b>	Location: Western Asia
<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>	<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
- GT: 4.33 MWel	- RH_1: 45%, Temp: 40°C	- GT: 16.6 MWel	- RH: 70%, Temp: 38°C
- CC: 57.0 MWel	- RH_1: 45%, Temp: 40°C	<b>(12) Barigozzi et al. (2011)</b>	Location: Southern Europe
	- RH_2: 45%, Temp: ≤18.5°C	<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
<b>(6) Kakaras et al. (2006)</b>	Location: Southern Europe	- CC_HD_1: 127.0 MWel	
<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>	- CC_HD_2: 127.0	- RH: 70%, Aver. Temp: 18°C
- CC_1: 560.0 MWel		- CC AD: 111.0 MWel	
- CC_2: 380.0 MWel	- RH: 50%, Aver. Temp: 26°C	<b>(13) Ebell et al. (1994)</b>	Location: Southern USA
- GT_1: 21.3 MWel		<i>Rated Power Output:</i>	<i>Ambient Conditions:</i>
- GT_2: 31.5 MWel		- CC: 285.0 MWel	- RH: 70%, Temp: -

The economic feasibility of the EC method is demonstrated at this point due to the low investment costs as compared to refrigeration methods. However, even that IF has the lowest investment costs, specific attention must be given as it may lead to erosion of the compressor blades which at the end may lead to unbearable cost compared to the investment costs of this technology. Furthermore, according to the available literature, the EC is

Table 3. Economics of the cooling method employed in each studied power plant.

No.	Type of power plant	Cooling Method	Associated costs of the cooling method	IRR (%)	Payback Period
(1)	CC_1	EC	Investment costs: 55\$/kW	24.37	3.9
	CC_2	IF	Investment costs: 45\$/kW	36.9	2.57
	CC_3	IF	Investment costs: 45\$/kW	31.24	3.01
(2)	-	-	-	-	-
(3)	GT	EC	Capital costs: 88.34\$/MWh	-	2.32
	GT	MR	Capital costs: 187.92 \$/MWh	-	2.62
	GT	(Novel) Turboexpander	Capital costs: 136.32 \$/MWh	-	2.28
(4)	GT	MR&Ice TES	-	-	4.72
(5)	-	-	-	-	-
(6)	CC_1	EC	ICOE: 35.76€/MWh	-	0.2
	CC_1	AR	ICOE: 37.92€/MWh	-	1.4
	CC_1	MR	ICOE: 46.96€/MWh	-	0.6
	CC_2	EC	ICOE: 24.39€/MWh	-	0.1
	CC_2	AR	ICOE: 29.2€/MWh	-	1.1
	CC_2	MR	ICOE: 39.03€/MWh	-	0.5
	GT_1	EC	ICOE: 58.92€/MWh	-	0.5
	GT_1	AR	ICOE: 74.06€/MWh	-	9.6
	GT_1	MR	ICOE: 103.05€/MWh	-	-
	GT_1	(Novel) EC	ICOE: 155.08€/MWh	-	-
	GT_2	EC	ICOE: 67.62€/MWh	-	0.3
	GT_2	AR	ICOE: 71.01€/MWh	-	3.2
	GT_2	MR	ICOE: 81.58€/MWh	-	3.1
GT_2	(Novel) EC	ICOE: 194.43€/MWh	-	-	
(7)	GT	MR&Ice TES	-	-	4–7.7
(8)	-	-	-	-	-
(9)	CC	EC	-	133.04	0.77
	CC	AR	-	9.78	8.44

(Continued)

Table 3. Continued

No.	Type of power plant	Cooling Method	Associated costs of the cooling method	IRR (%)	Payback Period
	CC	AR	-	31.4	3.28
	CC	MR	-	2.63	13.75
	CC	MR	-	22.53	4.49
	CC	AR&Ice TES	-	3.28	11.7
(10)	-	-	-	-	-
(11)	-	-	-	-	-
(12)	CC_HD_1	MR&Strat. TES	-	12.4	8.82
	CC_HD_2	MR&Strat. TES	-	11.1	9.75
	CC_AD	MR&Strat. TES	-	82.31	1.3
(13)		-	-	-	-

more appropriate to hot and dry locations. However, the water scarcity in such areas poses a significant constraint. Water is very expensive and valuable. Thus, more expensive refrigeration methods are required which highly increase the complexity and the capital cost of the system. Therefore, the installed cost of the cooling system in terms of cost per incremental power (ICOE) increase requires site-specific investigation. Based on the work of [Kakaras et al. \(2006\)](#) and in terms of ICOE, the EC method has the lowest cost and payback period, followed by the absorption chiller.

If a different strategy is sought combining higher power and flexibility enhancement, TES can become the most thermo-economically appropriate solution. The decoupled nature of this technology provides the ability to be used in the system whenever deemed necessary through advanced controlling systems. A conclusion that can be extracted from [Table 3](#) is that the integration of TES is comparable to the other methods concerning its economic aspect. The higher payback periods may be associated to the highest capital costs which are not available in the current studies. Moreover, if combined with the ability to exploit the stored energy during peak-hours it can result in a cost-effective way to improve both GT and overall cycle performance.

Based on the holistic approach of this section and the research in the available literature, it is found that the choice of each inlet cooling system depends on the location and the investment. Consequently, there is a need for combined technologies and advanced controls requiring optimization of such complex systems.

## State-of-the-art

### Optimization of inlet cooling systems with TES

The aforementioned systems have a multi-parametric behaviour which leads to the need of optimization through various algorithms. On one hand, the performance and environmental requirements such as efficiency and emissions that need to abide by new legislative frameworks. On the other hand, parameters that involve the economics of the system such as capital investment, maintenance expenses and operational costs.

Adding a TES in the GT inlet cooling system provides decoupling from the system, allowing to store energy during off-peak hours and make use of it whenever is required from the system. This decoupling provides extra degrees of freedom when managing power generation or consumption. For this reason, optimization algorithms are employed to find maximum/minimum values of the variables of the customized objective function. In this manner, constraints can be also considered.

The literature that focuses on time-dependent optimization problems is limited. One of the algorithms used includes sequential quadratic programming. Cole et al. (2014) considered a nonlinear model with capacity as a function of temperature, energy input ratio as a function of temperature and part load ratio and additional elements or constraints.

In another work (Sanaye et al., 2011), the authors employed two objective functions. The first one included capital and operational costs while the second added an exergy destruction cost rate. Moreover, Sanaye and Shirazi (2013) analysed an ice TES system model, from energy, exergy, economic and environmental aspects by applying multi-optimization techniques.

Furthermore, a mixed-integer linear programming problem is employed to determine the capacities of the equipment and maximum demands of utilities, based on operational strategies for seasonal and hourly changes in energy demands (Yokoyama and Ito, 2004). Palestra et al. (2008) developed a code in MATLAB to model and analyse the performance of the whole plant. They found that the economics of the inlet cooling system depend on the design parameters. Optimization of the problem utilizing various parameters led to lower installation costs and increased profitability. Another example of optimization (Shirazi et al., 2014) considered the two conflicting aspects in such topics. These are the thermodynamics and the economics of the application. Hence, a multi-objective genetic algorithm was employed to obtain optimal design parameters. The advantage of this method is the simultaneous processing of any of the conflicting objectives, also including constraints.

Based on the ongoing studies and the works that are available in the literature, it is emphasized that the dynamical behaviour is necessary for the development of a well-designed storage that will be adapted to satisfy a specific cooling demand.

## Driving towards the future

Apart from the emerging potential for advanced optimization of the systems presented herein, there is also the opportunity of advanced supervising controllers which will be able to generate the dynamic values based on the required electrical and thermal loads. The roadmap for the future indicates that decoupled components (such as TES for inlet cooling) combined with advanced control systems will provide benefits when considering the overall system efficiency. Innovative controls will allow for integrated inlet conditioning systems that will have the possibility to make use of each component whenever is needed and according to the economic profitability. Additionally, such systems will allow for the simultaneous studying of the inlet heating to overcome the limitation imposed by the icing formation.

Last but not least, the integration of TES with heat pumps can lead to utilizing unexploited sources of energy in power plants as it also appears in recent patents (Motakef and Feher, 2016). Additionally, an innovative layout is studied within the PUMP-HEAT project ([www.pumpheat.eu](http://www.pumpheat.eu)) which is a Horizon 2020 European project. In this layout, an innovative inlet conditioning system combines heat pumps with TES to provide both cooling and heating at the intake of the GT according to the operating conditions. The cooling condition is applied when power augmentation is needed during high electricity price periods. Inlet heating is applied to reduce Minimum Environmental Load during off-peak periods aiming to reduce fuel consumption and avoid daily start-ups.

## Concluding remarks

This article consists of a review study of the gas turbine inlet cooling mechanisms. Its focus is put on the use of thermal energy storage systems (TES) motivated by their potential of augmenting the GT power output and balancing the mismatch between energy demand and supply. Further improvement capabilities underlie in such systems if innovative phase change materials are employed. The conclusions that can be drawn from this review work are the following:

### *General conclusions:*

- There is no strict rule as to what cooling technology is the best to be applied in each configuration. The selection of each method depends on climatic and economic conditions combined with the power requirements of the respective network.
- TES are considered viable solutions for future energy production applications, due to decoupling of the refrigeration system from peak times. Decoupling necessitates the use of an integrated conditioning system through advanced controls, for the full exploitation of the power plant installed capacity.

- Latent heat TES have the strongest potential towards integrated inlet conditioning systems, due to their high energy density and compactness (compared to sensible heat TES) with the quasi-constant phase change temperatures, making them uniquely suitable for such applications where stabilization of GT air inlet temperature is important.
- The literature of TES in power production applications utilizing PCMs other than ice is limited. New PCMs can provide lower space requirements, larger cooling capacities and reduced size of the overall system with potentially feasible cost.

*Technical conclusions:*

- Power augmentation through GT inlet cooling varies from 2% to 30% based on the site climatological conditions, the method employed and the size of the power plant.
- The implementation of inlet cooling can have a negative effect in the overall combined cycle efficiency despite the performance improvement of the GT.
- Adding a TES leads to more than 10% power augmentation. Yet expensive, there is still high room for improvement in these technologies, if different materials are examined in power production applications.

## Nomenclature

---

AC	After Cooling
AD	Aeroderivative
AR	Absorption Refrigeration
CC	Combined Cycle
CHP	Combined Heat and Power
EC	Evaporative Cooling
HD	Heavy Duty
HEX	Heat Exchanger
HTF	Heat Transfer Fluid
ICOE	Incremental Cost of Electricity
IF	Inlet Fogging
IRR	Internal Rate of Return
ISO	International Organization for Standardization
LHTES	Latent Heat Thermal Energy Storage
MR	Mechanical Refrigeration
OEM	Original Equipment Manufacturer
O&M	Operations & Maintenance
PCM	Phase Change Material
RH	Relative Humidity
Aver	Average
Encap	Encapsulated
P <sub>x</sub>	Pressure at x condition
T <sub>x</sub>	Temperature at x condition

## Acknowledgements

---

None.

## Funding sources

---

This research work has been carried out within the PUMP-HEAT project, which has received funding from the European Union's Horizon 2020 research and innovation programme under grant agreement No 764706.

## Competing interest

---

Vasilis Gkoutzamanis, Anastasia Chatziangelidou, Theofilos Efstathiadis, Anestis Kalfas, Alberto Traverso and Justin Chiu declare that they have no conflict of interest.

## References

- Al-Ansary H. A., Orfi J. A., and Ali M. E. (2013). Impact of the use of a hybrid turbine inlet air cooling system in arid climates. *Energy Conversion and Management*. 75: 214–223. <https://doi.org/10.1016/j.enconman.2013.06.005>
- Al Bassam A. and Al Said Y. M. (2001). Qassim central power plant inlet air cooling system. In: ASME Turbo Expo 2001: Power for Land, Sea, and Air, volume 3, paper No. 2001-GT-0108. <https://doi.org/10.1115/2001-GT-0108>
- Alhazmy M. M. and Najjar Y. S. H. (2004). Augmentation of gas turbine performance using air coolers. *Applied Thermal Engineering*. 24 (2–3): 415–429. <https://doi.org/10.1016/j.applthermaleng.2003.09.006>
- Al-Ibrahim A. M. and Varnham A. (2010). A review of inlet air-cooling technologies for enhancing the performance of combustion turbines in Saudi Arabia. *Applied Thermal Engineering*. 30 (14–15): 1879–1888. <https://doi.org/10.1016/j.applthermaleng.2010.04.025>
- Ameri M. and Hejazi S. H. (2004). The study of capacity enhancement of the Chabahar gas turbine installation using an absorption chiller. *Applied Thermal Engineering*. 24 (1): 59–68. [https://doi.org/10.1016/S1359-4311\(03\)00239-4](https://doi.org/10.1016/S1359-4311(03)00239-4)
- Ameri M., Shahbazian H. R., and Nabizadeh M. (2007). Comparison of evaporative inlet air cooling systems to enhance the gas turbine generated power. *International Journal of Energy Research*. 31 (15): 1483–1503. <https://doi.org/10.1002/er.1315>
- Baakeem S. S., Orfi J., and Al-Ansary H. (2018). Performance improvement of gas turbine power plants by utilizing turbine inlet air-cooling (TIAC) technologies in Riyadh, Saudi Arabia. *Applied Thermal Engineering*. 138: 417–432. <https://doi.org/10.1016/j.applthermaleng.2018.04.018>
- Barigozzi G., Palestra N., Perdichizzi A., and Salvitti G. (2011). Combined cycle inlet air cooling by cold thermal storage: aeroderivative vs. heavy duty GT comparison. In: ASME Turbo Expo 2011, volume 4, paper No. GT2011-45997. 599–608. <https://doi.org/10.1115/GT2011-45997>
- Bédécarrats J. P. and Strub F. (2009). Gas turbine performance increase using an air cooler with a phase change energy storage. *Applied Thermal Engineering*. 29 (5–6): 1166–1172. <https://doi.org/10.1016/j.applthermaleng.2008.06.004>
- Bédécarrats J. P., Strub F., Falcon B., and Dumas J. P. (1996). Phase-change thermal energy storage using spherical capsules: performance of a test plant. *International Journal of Refrigeration*. 19 (3): 187–196. [https://doi.org/10.1016/0140-7007\(95\)00080-1](https://doi.org/10.1016/0140-7007(95)00080-1)
- Bhargava R. and Meher-Homji C. B. (2005). Parametric analysis of existing gas turbines with inlet evaporative and overspray fogging. *Journal of Engineering for Gas Turbines and Power*. 127 (1): 145–158. <https://doi.org/10.1115/1.1712980>
- Bianchi M., Branchini L., De Pascale A., Melino F., Peretto A., et al. (2010). Gas turbine power augmentation technologies: A systematic comparative evaluation approach. In: ASME Turbo Expo 2010: Power for Land, Sea, and Air, volume 5, paper No. GT2010-22948. <https://doi.org/10.1115/GT2010-22948>
- Boonnasa S., Namprakai P., and Muangnapoh T. (2006). Performance improvement of the combined cycle power plant by intake air cooling using an absorption chiller. *Energy*. 31 (12): 2036–2046. <https://doi.org/10.1016/j.energy.2005.09.010>
- Bracco S., Pierfederici A., and Trucco A. (2007). The wet compression technology for gas turbine power plants: Thermodynamic model. *Applied Thermal Engineering*. 27 (4): 699–704. <https://doi.org/10.1016/j.applthermaleng.2006.10.013>
- Cabeza L. F. (2015). *Advances in Thermal Energy Storage Systems*. Woodhead Publishing Series in Energy. Chapter 9 – Using solid-liquid phase change materials (PCMs) in thermal energy storage systems. ISBN: 978-1-78242-088-0. <https://doi.org/10.1016/C2013-0-16453-7>
- Cabeza L. F., Miró L., Oró E., de Gracia A., Martín V., et al. (2015). CO<sub>2</sub> mitigation accounting for thermal energy storage (TES) case studies. *Applied Energy*. 155: 365–377. <https://doi.org/10.1016/j.apenergy.2015.05.121>
- Chacartegui R., Jiménez-Espadafor F., Sánchez D., and Sánchez T. (2008). Analysis of combustion turbine inlet air cooling systems applied to an operating cogeneration power plant. *Energy Conversion and Management*. 49 (8): 2130–2141. <https://doi.org/10.1016/j.enconman.2008.02.023>
- Cheralathan M., Velraj R., and Renganarayanan S. (2007). Performance analysis on industrial refrigeration system integrated with encapsulated PCM-based cool thermal energy storage system. *International Journal of Energy Research*. 31 (14): 1398–1413. <https://doi.org/10.1002/er.1313>
- Chiu J. N. W. and Martin V. (2012). Submerged finned heat exchanger latent heat storage design and its experimental verification. *Applied Energy*. 93: 507–516. <https://doi.org/10.1016/j.apenergy.2011.12.019>
- Cole W. J., Rhodes J. D., Powell K. M., and Edgar T. F. (2014). Turbine inlet cooling with thermal energy storage. *International Journal of Energy Research*. 38 (2): 151–161. <https://doi.org/10.1002/er.3014>
- De Lucia M., Lanfranchi C., and Boggio V. (1996). Benefits of Compressor Inlet Air Cooling for Gas Turbine Cogeneration Plants. *Journal of Engineering for Gas Turbines and Power*. 118 (3): 598–603. <https://doi.org/10.1115/1.2816690>
- Dincer I. and Rosen M. A. (2010). *Thermal Energy Storage: Systems and Applications*. UK: Wiley, 2nd edition, ISBN: 978-0-470-74706-3.
- Ebelling J., Balsbaugh R., Blanchard S., and Beaty L. (1994). Thermal energy storage and inlet air cooling for combined cycle. In: ASME International Gas Turbine and Aeroengine Congress and Exposition, volume 4, paper No. 94-GT-310. <https://doi.org/10.1115/94-GT-310>
- Eser P., Chokani N., and Abhari R. S. (2017). Operational and financial performance of fossil fuel power plants within a high renewable energy mix. *Journal of the Global Power and Propulsion Society*. 1: 16–27. <https://doi.org/10.22261/2BIOTO>
- Farzaneh-Gord M. and Deymi-Dashtebayaz M. (2011). Effect of various inlet air cooling methods on gas turbine performance. *Energy*. 36 (2): 1196–1205. <https://doi.org/10.1016/j.energy.2010.11.027>
- Felix Regín A., Solanki S. C., and Saini J. S. (2009). An analysis of a packed bed latent heat thermal energy storage system using PCM capsules: Numerical investigation. *Renewable Energy*. 34 (7): 1765–1773. <https://doi.org/10.1016/j.renene.2008.12.012>
- Gareta R., Romeo L. M., and Gil A. (2004). Methodology for the economic evaluation of gas turbine air cooling systems in combined cycle applications. *Energy*. 29 (11): 1805–1818. <https://doi.org/10.1016/j.energy.2004.03.040>
- Gülen S. C. (2017). Pressure gain combustion advantage in land-based electric power generation. *Journal of the Global Power and Propulsion Society*. 1: 288–302. <https://doi.org/10.22261/JGPPS.K4MD26>
- Hasnain S. M. (1998). Review on sustainable thermal energy storage technologies, Part II: cool thermal storage. *Energy Conversion and Management*. 39 (11): 1139–1153. [https://doi.org/10.1016/S0196-8904\(98\)00024-7](https://doi.org/10.1016/S0196-8904(98)00024-7)



- Ibrahim H., Ilinca A., and Perron J. (2008). Energy storage systems – Characteristics and comparisons. *Renewable and Sustainable Energy Reviews*. 12 (5): 1221–1250. <https://doi.org/10.1016/j.rser.2007.01.023>
- Kakaras E., Doukelis A., and Karellas S. (2004). Compressor intake-air cooling in gas turbine plants. *Energy*. 29 (12-15): 2347–2358. <https://doi.org/10.1016/j.energy.2004.03.043>
- Kakaras E., Doukelis A., Prelipceanu A., and Karellas S. (2006). Inlet air cooling methods for gas turbine based power plants. *Journal of Engineering for Gas Turbines and Power*. 128 (2): 312–317. <https://doi.org/10.1115/1.2131888>
- Kim T. S. and Ro S. T. (2000). Power augmentation of combined cycle power plants using cold energy of liquefied natural gas. *Energy*. 25 (9): 841–856. [https://doi.org/10.1016/S0360-5442\(00\)00018-9](https://doi.org/10.1016/S0360-5442(00)00018-9)
- Kwon H. M., Kim J. H., and Kim T. S. (2016). Gas turbine performance enhancement by inlet air cooling and coolant pre-cooling using an absorption chiller. In: *ASME Turbo Expo 2016*, volume 3, paper No. GT2016-58014. <https://doi.org/10.1115/GT2016-58014>
- Meher-Homji C. B. and Mee III T. R. (2000). Inlet fogging of gas turbine engines: Part A – Theory, Psychometrics and fog generation. In: *ASME Turbo Expo 2000*, volume 3, paper No. 2000-GT-0307. <https://doi.org/10.1115/2000-GT-0307>
- Motakef A. and Feher P. (2016). Turbine inlet air heat pump-type system. US Patent: US-9470149-B2.
- Mouneer T. A., El-Morsi M. S., Nosier M. A., and Mahmoud N. A. (2010). Heat performance of a newly developed ice slurry generator: A comparative study. *Ain Shams Engineering Journal*. 1 (2): 147–157. <https://doi.org/10.1016/j.asej.2011.05.004>
- Palestra N., Barigozzi G., and Perdichizzi A. (2008). Inlet air cooling applied to combined cycle power plants: influence of site climate and thermal storage systems. *Journal of Engineering for Gas Turbines and Power*. 130 (2): 022002. <https://doi.org/10.1115/1.2771570>
- Ponce Arrieta F. R. and Silva Lora E. E. (2005). Influence of ambient temperature on combined-cycle power-plant performance. *Applied Energy*. 80 (3): 261–272. <https://doi.org/10.1016/j.apenergy.2004.04.007>
- PUMP-HEAT. H2020 EU Funded Project, No. 764706. <https://pumpheat.eu>
- Quinnell J. A., Davidson J. H., and Burch J. (2010). Liquid calcium chloride solar storage: Concept and analysis. In: *ASME 4th International Conference on Energy Sustainability*, volume 2, paper No. ES2010-90181. 715–724. <https://doi.org/10.1115/ES2010-90181>
- Saito A. (2002). Recent advances in research on cold thermal energy storage. *International Journal of Refrigeration*. 25 (2): 177–189. [https://doi.org/10.1016/S0140-7007\(01\)00078-0](https://doi.org/10.1016/S0140-7007(01)00078-0)
- Sanaye S. and Shirazi A. (2013). Four E analysis and multi-objective optimization of an ice thermal energy storage for air-conditioning applications. *International Journal of Refrigeration*. 36: 828–841. <https://doi.org/10.1016/j.ijrefrig.2012.10.014>
- Sanaye S., Fardad A., and Mostakhdemi M. (2011). Thermoeconomic optimization of an ice thermal storage system for gas turbine inlet cooling. *Energy*. 36 (2): 1057–1067. <https://doi.org/10.1016/j.energy.2010.12.002>
- Shirazi A., Najafi B., Aminyavari M., Rinaldi F., and Taylor R. A. (2014). Thermal-economic-environmental analysis and multi-objective optimization of an ice thermal energy storage system for gas turbine cycle inlet air cooling. *Energy*. 69: 212–226. <https://doi.org/10.1016/j.energy.2014.02.071>
- Sigler J., Erickson D., and Perez-Blanco H. (2001). Gas turbine inlet air cooling using absorption refrigeration: A comparison based on a combined cycle process. In: *ASME Turbo Expo 2001*, volume 3, paper No. 2001-GT-0408. <https://doi.org/10.1115/2001-GT-0408>
- Veerakumar C. and Sreekumar A. (2016). Phase change material based cold thermal energy storage: Materials, techniques and applications – A review. *International Journal of Refrigeration*. 67: 271–289. <https://doi.org/10.1016/j.ijrefrig.2015.12.005>
- Vitorino N., Abrantes J. C. C., and Frade J. R. (2016). Quality criteria for phase change materials selection. *Energy Conversion and Management*. 124: 598–606. <https://doi.org/http://dx.doi.org/10.1016/j.enconman.2016.07.063>
- Wang F. J. and Chiou J. S. (2004). Integration of steam injection and inlet air cooling for a gas turbine generation system. *Energy Conversion and Management*. 45 (1): 15–26. [https://doi.org/10.1016/S0196-8904\(03\)00125-0](https://doi.org/10.1016/S0196-8904(03)00125-0)
- Winkler D., Geng W., Engelbrecht G., Stuber P., Knapp K., and Griffin T. (2017). Staged combustion concept for gas turbines. *Journal of the Global Power and Propulsion Society*. 1: 184–194. <https://doi.org/10.22261/CVLCX0>
- Yokoyama R. and Ito K. (2004). Effect of inlet air cooling by ice storage on unit sizing of a gas turbine cogeneration plant. *Journal of Engineering for Gas Turbines and Power*. 126 (2): 351–357. <https://doi.org/10.1115/1.1692011>
- Youssef Z., Delahaye A., Huang L., Trinquet F., Fournaison L., et al. (2013). State of the art on phase change material slurries. *Energy Conversion and Management*. 65: 120–132. <https://doi.org/10.1016/j.enconman.2012.07.004>